ALZ-35

Ød	18	25	33
	(25-32)/18	(32-39)/25	(40-50)/33

Technical requirement :

1. Type A Hardness : 40±5° A

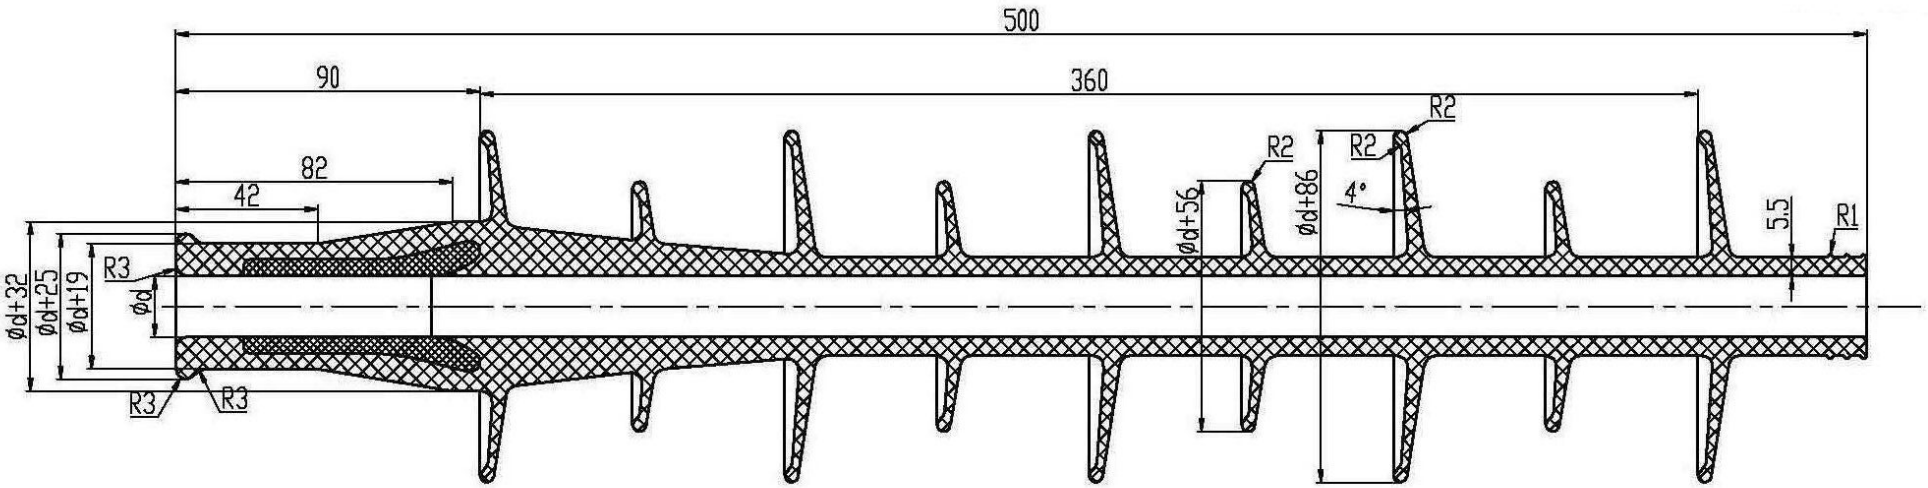

					AMPLETEK GUANG DONG AMPLE TECHNOLOGY CO., LTD.
ReV.	Mark	Dco.NO	Sign	Date	Material: SR / Description: 35kV Outdoor termination
Design					Drawing No.: / P/N:
Checking					
Approved					Page of / Re.V: A